

BOSTIK, INC.

SEISMIC PERFORMANCE SUMMARY REPORT

SCOPE OF WORK

AAMA 501.6 DYNAMIC SEISMIC DRIFT TESTS ON PORCELAIN PANEL FAÇADE SYSTEM
INSTALLED WITH BOSTIK PANELTACK SYSTEM

REPORT NUMBER

M5942.02-301-32-R1

TEST DATE

12/20/21

ISSUE DATE

02/10/22

REVISION DATE

05/09/22

RECORD RETENTION END DATE

12/20/31

PAGES


13

DOCUMENT CONTROL NUMBER

ATI 00597 (07/28/17)

RT-R-AMER-Test-2854

© 2017 INTERTEK

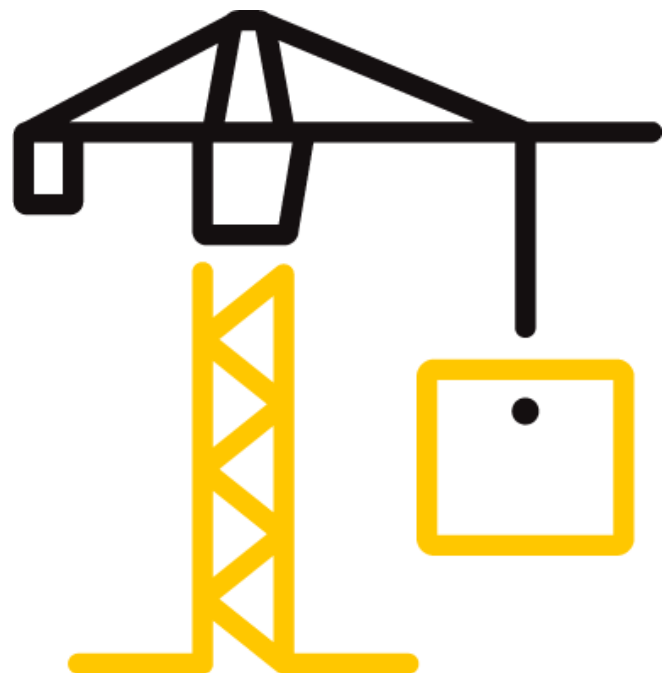

TEST REPORT FOR BOSTIK, INC.

Report No.: M5942.02-301-32-R1

Date: 05/09/22

REPORT ISSUED TO

BOSTIK, INC.

11320 Watertown Plank Road
Wauwatosa, Wisconsin 53226

SCOPE

Intertek Building & Construction (B&C) was contracted by Bostik, Inc. to perform seismic performance testing in accordance with AAMA 501.6 to determine the dynamic seismic drift causing glass fallout on their Porcelain Panel Façade System installed with Bostik PanelTack System. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted at Intertek B&C test facility in Fresno, California.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SUMMARY OF TEST RESULTS

Based on the results of the dynamic racking tests included herein, the test specimen met 6.0" $\Delta_{fallout}$ drift performance requirements of AAMA 501.6.

For INTERTEK B&C:

COMPLETED BY:	Ricardo Cortez	REVIEWED BY:	Tyler Westerling, P.E.
TITLE:	Technician	TITLE:	Operations Manager
SIGNATURE:		SIGNATURE:	
DATE:	05/09/22	DATE:	05/09/22

EC:ms/ss

The specimen was evaluated in accordance with the following:

AAMA 501.6-18, Recommended Dynamic Test Method for Determining the Seismic Drift Causing Glass Fallout from Window Wall, Curtain Wall, and Storefront System

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.