

# UL-EU CERTIFICATE

**Certificate No.** UL-EU-01134-CPR

**Page** 1/44

**Date of Issue** 2020-04-29

**Certificate Holder** Bostik BV  
Denariusstraat 11  
4903 RC Oosterhout  
The Netherlands

**Manufacturer** A/003

**Certified Product Type** Fire Stop - Sealant  
**Product Trade Name** Bostik FP 310 Intumescent Acoustic Acrylic  
**Trademark** N/A  
**Rating/Classification** See Appendix

**Expiry date** 2030-04-28



A handwritten signature in purple ink, appearing to read 'Chris Miles', is located in the lower-left quadrant of the page.

---

**Authorized Certification Decision Maker**  
Chris Miles

This is to certify that representative samples of the Certified Product listed above have been investigated by Underwriters Laboratories to the Standard(s) indicated on this Certificate, in accordance with the UL Global Services Agreement and the UL-EU Mark Service Terms and Conditions ("Agreement"). The Certificate Holder is entitled to use the UL-EU Mark for the Certified Product listed on the certificate and manufactured at the production site(s) listed, in accordance with the terms of the Agreement. Only those products bearing the UL-EU Mark for Europe should be considered as being covered by UL's UL-EU Mark Service. This Certificate shall remain valid through the Expiration date, unless a Standard identified on this Certificate is amended or withdrawn prior to that date or there is a non-compliance with the Agreement.



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
Page 2/44  
Date of Issue 2020-04-29

This certificate relates to the use of Bostik FP 310 Intumescent Acoustic Acrylic for fire stopping where there are joints in or between walls & floors or service penetrations through floors and walls. The detailed scope is given in pages 3 to 43 of this Certificate. This shows the thickness and acceptable dimensions, substrates and orientations required to provide fire resistance periods of up to 240 minutes for differing services and wall/floor constructions.

The product is certificated on the basis of:

- i) Inspection and surveillance of factory production control by UL
- ii) Fire resistance test data in accordance with EN 1366-3 and 1366-4
- iii) Classification in accordance with EN 13501-2
- iv) Durability and Serviceability as defined in EAD 350141-00-1106\*

\* Bostik FP 310 Intumescent Acoustic Acrylic sealant has been tested in accordance with BS EN ISO 8339: 2005 and BS EN ISO 9046: 2004 to demonstrate its suitability for use in internal conditions with humidity lower than 85 % RH, excluding temperatures below 0°C, without exposure to rain or UV. These conditions are designated Z<sub>2</sub> in EAD 350454-00-1104, September 2017 and EAD 350141-00-1106.

The movement capability of Bostik FP 310 Intumescent Acoustic Acrylic joint seals is restricted to ≤ 7.5%

Bostik FP 310 Intumescent Acoustic Acrylic is a sealant used to form a penetration seal around metallic pipes with and without combustible insulation, plastic pipes, combustible cable conduits, composite pipes and electrical cables to reinstate the fire resistance performance of wall and floor constructions, where they have been provided with apertures for the penetration of services. It is also used to form linear gap seals where gaps are present in wall and floor constructions and linear joint seals where wall and floor constructions abut.

Bostik FP 310 Intumescent Acoustic Acrylic is supplied in liquid form contained within 310 ml & 380 ml cartridges and 600 ml foil packs. The sealant is gunned into the aperture in the separating element/elements and around the service or services, to a specified depth utilising a backing material.



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 3/44  
 Date of Issue 2020-04-29

Product: Bostik FP 310 Intumescent Acoustic Acrylic		
Product-type: Sealant		Intended use: Linear Joint, Gap Seal & Penetration Seal
Assessment method	Essential characteristic	Product Performance
<b>BWR 2 Safety in case of fire</b>		
EN 13501-1	Reaction to fire	Class D-s1, d1
EN 13501-2	Resistance to fire	See pages 5 to 43
<b>BWR 3 Hygiene, health and environment</b>		
Declaration of manufacturer & EN 16516	Content, emission and/or release of dangerous substances	Use categories: IA1 Declaration of manufacturer
EN 1026:2000	Air permeability (material property)	No performance determined
EAD 350141-00-1106, Annex C & EN 12390-8	Water permeability (material property)	No performance determined
<b>BWR 4 Safety in use</b>		
EOTA TR 001:2003	Mechanical resistance and stability	No performance determined
EOTA TR 001:2003	Resistance to impact/movement	No performance determined
EOTA TR 001:2003 ISO 11600 & EAD 350141-00-1106, Clause 2.2.13	Adhesion	No performance determined
EAD 350141-00-1106, Clause 2.2.12	Durability	Z <sub>2</sub>
EAD 350141-00-1106, Clause 2.2.13	Movement capacity	No performance determined
EAD 350141-00-1106, Clause 2.2.14	Cycling of perimeter seals for curtain walls	No performance determined
EAD 350141-00-1106, Clause 2.2.15	Compression set	No performance determined
EAD 350141-00-1106, Clause 2.2.16	Linear expansion on setting	No performance determined
<b>BWR 5 Protection against noise</b>		
EN 10140-1,2,4,5/ EN ISO 717-1	Airborne sound insulation	Rw(C;Ctr)= 62 (-1;-5) dB*
<b>BWR 6 Energy economy and heat retention</b>		
EN 12664, EN 12667, EN 12939, EN ISO 8990, EN ISO 6946, EN ISO 10456	Thermal properties	No performance determined
EN ISO 12572, EN 12086, EN ISO 10456	Water vapour permeability	No performance determined
*12 mm depth and only applicable to linear joint and gap seals		






# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 4/44  
 Date of Issue 2020-04-29

## Bostik FP 310 Intumescent Acoustic Acrylic: Acoustic performance according to BS EN ISO 10140-2:2010

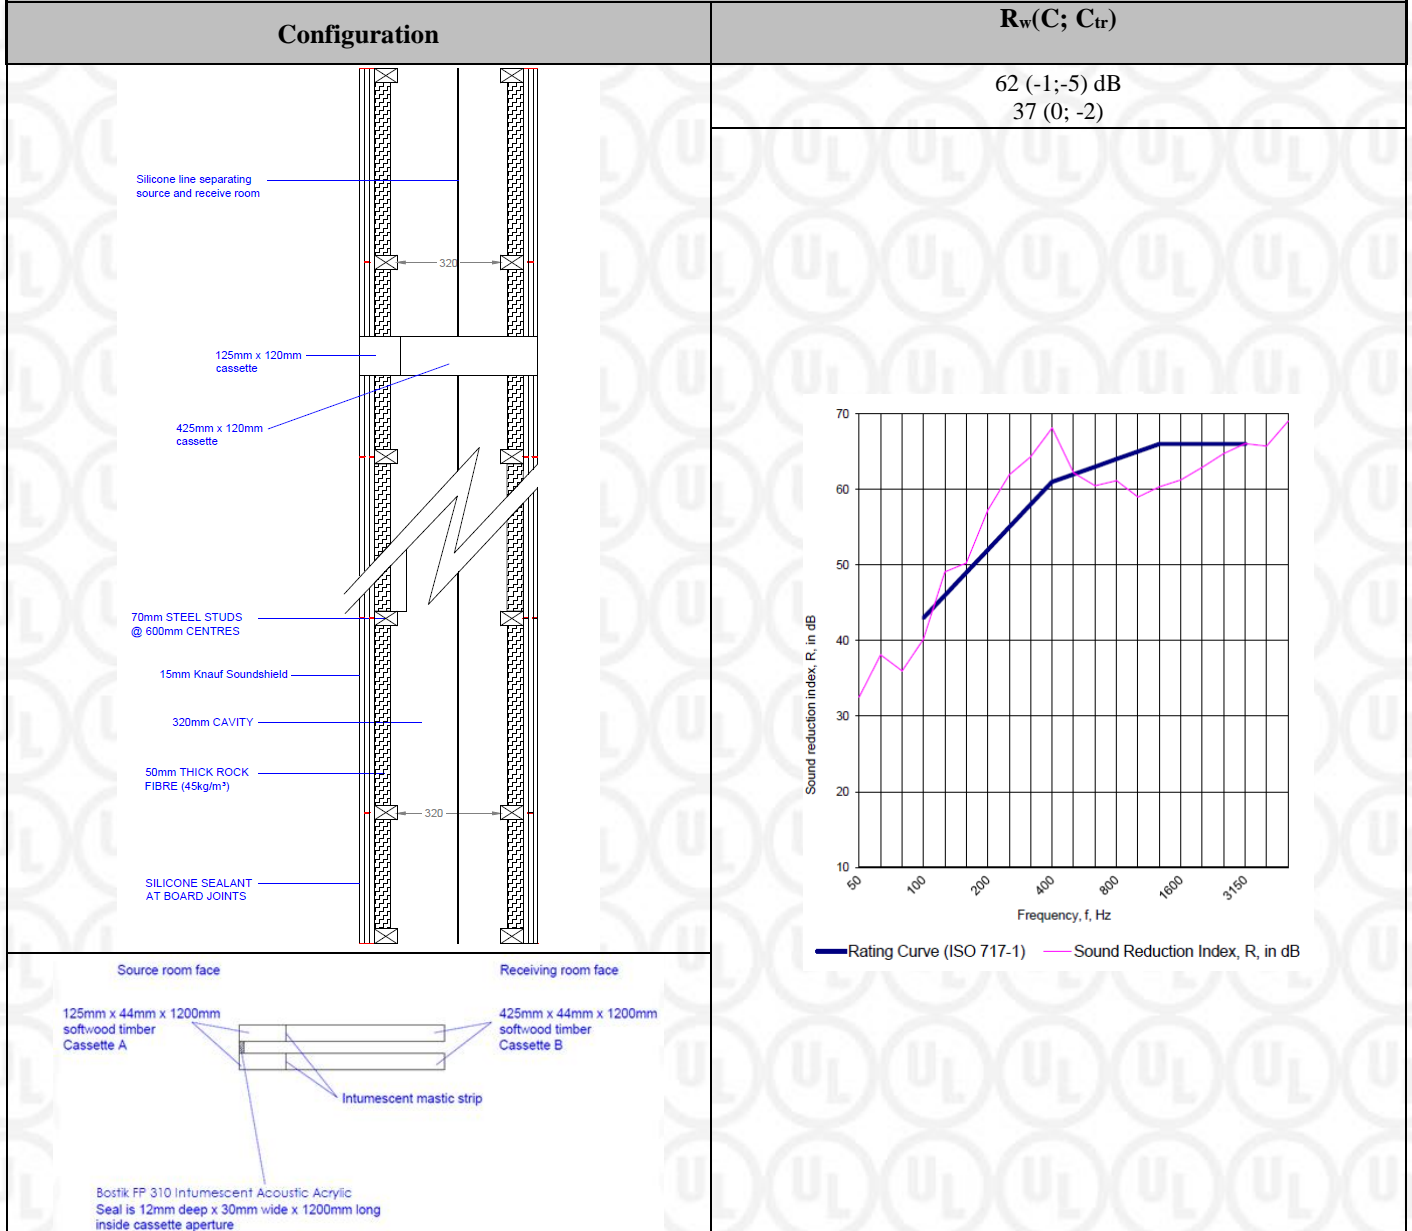

# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 5/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Walls								
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Sealant Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Maximum Seal Size	Fire Resistance (mins.)	
							E	EI
Masonry/ Concrete	150	Single electrical cables up to 21 mm Ø	25 (to either face of wall)	AES Fibre $\geq$ 128kg/m <sup>3</sup>	48	87 mm Ø	240	90
		Blank seals				300 x 300 mm	240	60
		Single electrical cables up to 21 mm Ø						
		Blank seals						
Single electrical cables up to 21 mm Ø	35 x 35 mm / 36 mm Ø	240	120					

Minimum separation between cables and the edge of the seal of 7 mm.



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 6/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided Penetration Seals in Walls								
Substrate	Minimum Substrate Thickness (mm)	Services	Sealant Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Maximum Seal Size	Fire Resistance (mins.)	
							E	EI
Masonry/ Concrete	150	Blank seals	15	Stone wool 35 kg/m <sup>3</sup>	25	300 x 300 mm	240	240
		Electric cables up to 21 mm diameter, single or in a bundle.					240	120
		Electric cables 22-80 mm diameter, single or in a bundle.					120	60
		Blank seals	25	AES Fibre ≥ 128kg/m <sup>3</sup>	48		240	240
		Electric cables up to 80 mm diameter, single or in a bundle.					240	60
		Telecoms cables up to 21 mm diameter, single or in a bundle up to 100 mm diameter					240	240

Minimum separation between cables and the edge of the seal of 10 mm



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 7/44  
 Date of Issue 2020-04-29

## Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Walls 15 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 20 mm deep minimum 40 kg/m<sup>3</sup> stone wool backing

Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Seal Width Around Pipe (mm)	Insulation LI or CI	Fire Resistance (mins.)	
					E	EI
Masonry/Concrete	150	Copper pipe up to 54 mm diameter/0.9-14.2 mm wall	8-9	1000 mm length 20 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	180
		Copper pipe up to 12 mm diameter/0.9-5 mm wall	8		240	240
		Alupex composite pipe 75 mm diameter/7.5 mm wall	30	25 mm AES Fibre ≥ 128kg/m <sup>3</sup> insulation, 600 mm long (min.)	120	120
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Seal Width Around Pipe (mm)	Insulation LI or CI	Fire Resistance (mins.)	
					E	EI
Masonry/Concrete	150	40 mm diameter/1.5-14.2 mm wall*	6-18	1000 mm length of 20 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	240
		40 mm diameter/1.5-14.2 mm wall*				
		50 mm diameter/1.7-14.2 mm wall*		1000 mm length of 30 mm Stone wool insulation 80 kg/m <sup>3</sup>	180	90
		60 mm diameter/1.9-14.2 mm wall*				
		75 mm diameter/2.2-14.2 mm wall*				
		90 mm diameter/2.5-14.2 mm wall*				
		100 mm diameter/2.7-14.2 mm wall*				
		115 mm diameter/3-14.2 mm wall*				
		140 mm diameter/3.5-14.2 mm wall*				
		165 mm diameter/ 3.9-14.2 mm wall*				
		180 mm diameter/ 4.2-14.2 mm wall*				
		200 mm diameter/ 4.6-14.2 mm wall*				
219 diameter/ 5.0-14.2 mm wall*						

LI = Local Interrupted  
 CI = Continuous Interrupted

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 8/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Walls 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 25 mm deep 40 kg/m<sup>3</sup> stone wool backing</b>						
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Maximum Seal Size (mm)	Insulation LI or CI	Fire Resistance (mins.)	
					E	EI
Masonry/Concrete	150	Copper pipe up to 54 mm diameter/0.9-14.2 mm wall	300 x 300	1000 mm length 20 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	60
		Alupex composite pipe 75 mm diameter/7.5 mm wall		25 mm AES Fibre ≥ 128kg/m <sup>3</sup> insulation, 600 mm long (min.)		
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Maximum Seal Size (mm)	Insulation LI or CI	Fire Resistance (mins.)	
					E	EI
Masonry/Concrete	150	40 mm diameter/1.5-14.2 mm wall*	300 x 300	1000 mm length of 20 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	60
		40 mm diameter/1.5-14.2 mm wall*				
		50 mm diameter/1.7-14.2 mm wall*				
		60 mm diameter/1.9-14.2 mm wall*				
		75 mm diameter/2.2-14.2 mm wall*				
		90 mm diameter/2.5-14.2 mm wall*				
		100 mm diameter/2.7-14.2 mm wall*				
		115 mm diameter/3-14.2 mm wall*				
		140 mm diameter/3.5-14.2 mm wall*				
		165 mm diameter/ 3.9-14.2 mm wall*				
		180 mm diameter/ 4.2-14.2 mm wall*				
		200 mm diameter/ 4.6-14.2 mm wall*				
219 mm diameter/ 5.0-14.2 mm wall*						
				1000 mm length of 30 mm Stone wool insulation 80 kg/m <sup>3</sup>		

LI = Local Interrupted  
 CI = Continuous Interrupted

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 9/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Walls 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 48 mm deep AES Fibre $\geq 128\text{kg/m}^3$ backing - Maximum seal size 300 x 300 mm or 504 mm $\varnothing$						
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Seal Width Around Pipe (mm)	Insulation CS	Fire Resistance (mins.)	
					E	EI
Masonry/ Concrete	150	40 mm diameter/1.0-14.2 mm wall*	10	20 mm thick stone, mineral wool min. 80 kg/m <sup>3</sup>	240	240
		40 mm diameter/1.0-14.2 mm wall*		30-80 mm thick stone, mineral wool min. 80 kg/m <sup>3</sup>	180	180
		50 mm diameter/1.2-14.2 mm wall*				
		60 mm diameter/1.4-14.2 mm wall*				
		75 mm diameter/1.6-14.2 mm wall*				
		90 mm diameter/1.9-14.2 mm wall*				
		100 mm diameter/2.1-14.2 mm wall*				
		115 mm diameter/2.4-14.2 mm wall*				
		140 mm diameter/2.9-14.2 mm wall*				
		165 mm diameter/ 3.4-14.2 mm wall*				
		180 mm diameter/ 3.6-14.2 mm wall*				
		200 mm diameter/ 4.0-14.2 mm wall*				
		219 mm diameter/ 4.3-14.2 mm wall*				
		250 mm diameter/ 5.0-14.2 mm wall*				
		300 mm diameter/ 5.9-14.2 mm wall*				
324 mm diameter/ 6.35-14.2 mm wall*						

CS = Continuous Sustained

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 10/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Walls 15 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 20 or 30 mm deep minimum 40 kg/m<sup>3</sup> stone wool backing</b>						
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Maximum Seal Size (mm)	Insulation LI or CI	Fire Resistance (mins.)	
					E	EI
Masonry/ Concrete	150	40 mm diameter/1.5-14.2 mm wall*	300 x 300	1000 mm length of 20 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	240
		40 mm diameter/1.5-14.2 mm wall*		1000 mm length of 30 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	120
		50 mm diameter/1.7-14.2 mm wall*				
		60 mm diameter/1.9-14.2 mm wall*				
		75 mm diameter/2.2-14.2 mm wall*				
		90 mm diameter/2.5-14.2 mm wall*				
		100 mm diameter/2.7-14.2 mm wall*				
		115 mm diameter/3-14.2 mm wall*				
		140 mm diameter/3.5-14.2 mm wall*				
		165 mm diameter/ 3.9-14.2 mm wall*				
		180 mm diameter/ 4.2-14.2 mm wall*				
		200 mm diameter/ 4.6-14.2 mm wall*				
		219 mm diameter/ 5.0-14.2 mm wall*				

LI = Local Interrupted  
 CI = Continuous Interrupted

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 11/44  
 Date of Issue 2020-04-29

**Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided\*\* Penetration Seals in Walls 15 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 25 mm deep stone wool insulation minimum 35 kg/m<sup>3</sup> backing - Maximum seal size 300 x 300 mm or 504 mm Ø**


Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Seal Width Around Pipe (a1)	Insulation CS	Fire Resistance (mins.)	
					E	EI
Masonry/ Concrete	150	40 mm diameter/1.0-14.2 mm wall*	10 mm	20 mm stone, mineral wool min. 80 kg/m <sup>3</sup>	240	240
		40 mm diameter/1.0-14.2 mm wall*				
		50 mm diameter/1.2-14.2 mm wall*				
		60 mm diameter/1.4-14.2 mm wall*				
		75 mm diameter/1.6-14.2 mm wall*				
		90 mm diameter/1.9-14.2 mm wall*				
		100 mm diameter/2.1-14.2 mm wall*				
		115 mm diameter/2.4-14.2 mm wall*				
		140 mm diameter/2.9-14.2 mm wall*				
		165 mm diameter/ 3.4-14.2 mm wall*				
		180 mm diameter/ 3.6-14.2 mm wall*				
		200 mm diameter/ 4.0-14.2 mm wall*				
		219 mm diameter/ 4.3-14.2 mm wall*				
		250 mm diameter/ 5.0-14.2 mm wall*				
300 mm diameter/ 5.9-14.2 mm wall*						
324 mm diameter/ 6.35-14.2 mm wall*						
				30-80 mm thick stone, mineral wool min. 80 kg/m <sup>3</sup>		

CS = Continuous Sustained

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal applied to both sides of the wall

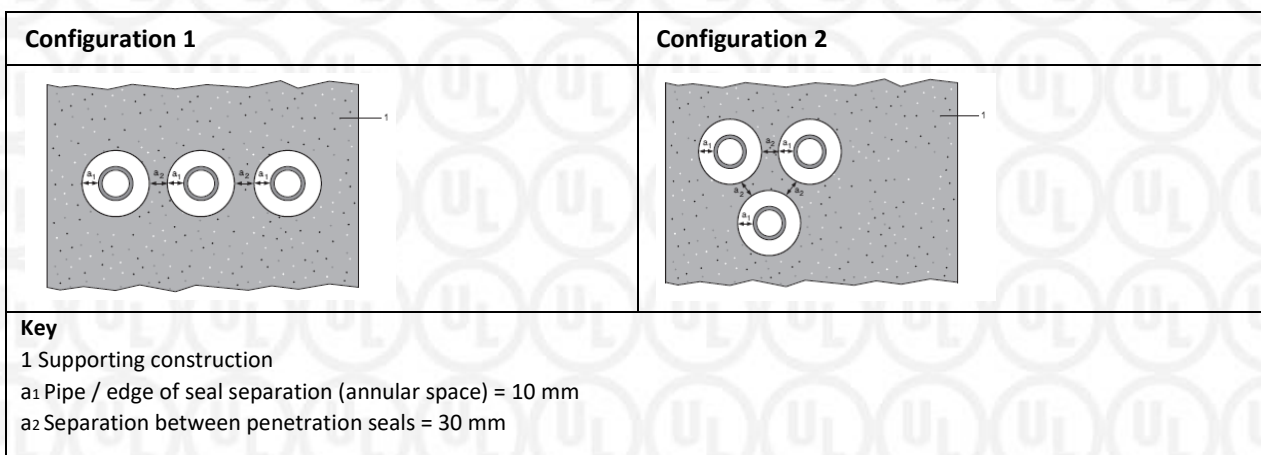



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 12/44  
 Date of Issue 2020-04-29


## Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided\*\* Penetration Seals in Walls 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 25 mm deep stone wool insulation minimum 35 kg/m<sup>3</sup> backing - Maximum seal size 300 x 300 mm or 300 mm Ø

Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Seal Width Around Pipe (a1)	Insulation CS	Fire Resistance (mins.)	
					E	EI
Masonry/ Concrete	150	22 mm diameter/2-11 mm wall	10 mm	13 mm thick Elastomeric insulation minimum class B-s3,d0	240	180
		22-114 mm diameter/2-14.2 mm wall		13-25 mm thick Elastomeric insulation minimum class B-s3,d0	120	90
		22-114 mm diameter/2-14.2 mm wall		25-50 mm thick Elastomeric insulation minimum class B-s3,d0	60	60

CS = Continuous Sustained

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\*\* seal applied to both sides of the wall

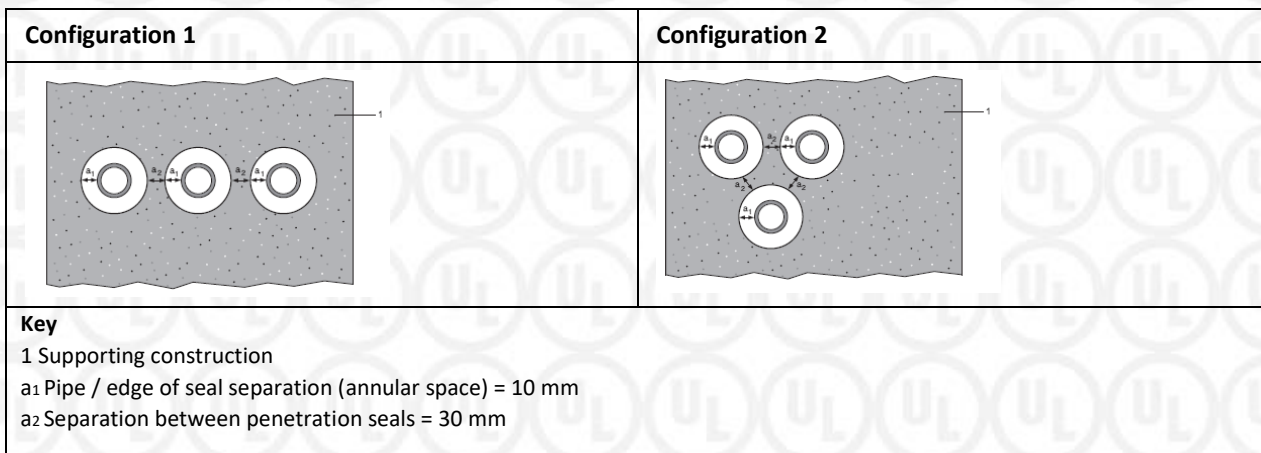

# Appendix UL-EU CERTIFICATE


Certificate No. UL-EU-01134-CPR  
 Page 13/44  
 Date of Issue 2020-04-29

## Bostik FP 310 Intumescent Acrylic: Double Sided\*\* Penetration Seals in Walls 25 mm deep Bostik FP 310 Intumescent Acrylic / 25 mm deep stone wool insulation minimum 35 kg/m<sup>3</sup> backing - Maximum seal size 300 x 300 mm or 300 mm Ø

Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Seal Width Around Pipe (a1)	Sealant Depth (mm)	Backing Material	Fire Resistance (mins.)	
						E	EI
Masonry/ Concrete	150	PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1 6-32 mm Ø/1.0-1.6 mm wall	10 mm	25	25 mm stone wool insulation min. 35 kg/m <sup>3</sup>	240	240
		PP pipe according to EN 1451-1 32 mm Ø/2.0-4.4 mm wall				180	180
		PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1 20-32 mm Ø /2.0 mm wall				240	240

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped) Except PVC-U pipes which are U/C.

\*\* seal applied to both sides of the wall

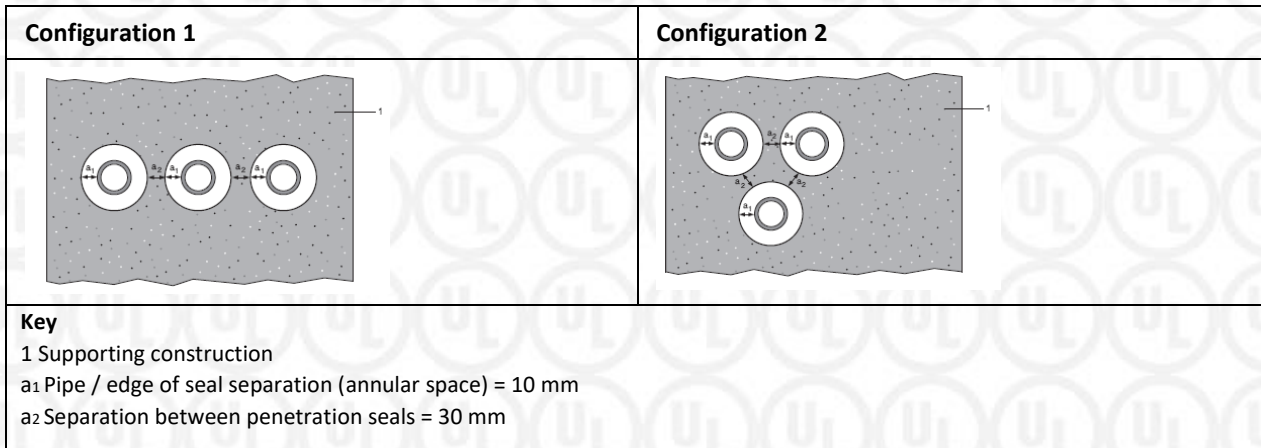

# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 14/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Walls</b>							
Substrate	Minimum Substrate Thickness (mm)	Services	Sealant Depth (mm)	Backing Material	Maximum Seal Size	Fire Resistance (mins.)	
						E	EI
Drywall/ Masonry/ Concrete	75	None (blank)	12.5	Any material	150 x 150 mm <sup>^</sup>	60	60
		Electric cables up to 21 mm Ø, single		none		60	45
		Electric cables up to 21 mm Ø, in bundles up to 100 mm Ø				45	30
Mild or stainless steel pipe							
Drywall/ Masonry/ Concrete	75	4 mm diameter /0.7-2.0 mm wall	12.5	none	150 x 150 mm <sup>^</sup>	60	45
		5-22 mm diameter /0.7-11 mm wall*				60	30
Mild or stainless steel pipe with minimum 80 kg/m <sup>3</sup> density stone wool insulation Continuous Sustained (CS)							
Drywall/ Masonry/ Concrete	75	40 mm diameter /1-14.2 mm wall, 20 mm insulation	12.5	none	150 x 150 mm <sup>^</sup>	60	45
		40-324 mm diameter /1.0-14.2 mm wall, 30 mm insulation*					
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1							
Drywall/ Masonry/ Concrete	75	6-32 mm Ø/1.0-1.8 mm wall, with bundle of cables up to 21 mm diameter*	12.5	none	150 x 150 mm <sup>^</sup>	60	45
PP pipe according to EN 1451-1							
Drywall/ Masonry/ Concrete	75	20 mm Ø/2.3 mm wall	12.5	none	150 x 150 mm <sup>^</sup>	45	45
		21-32 mm Ø/2.3-4.4 mm wall*				30	30
		21-32 mm Ø/2.3-4.4 mm wall, with bundle of cables up to 21 mm diameter*				45	30
PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1							
Drywall/ Masonry/ Concrete	75	20 mm Ø/2.0 mm wall	12.5	none	150 x 150 mm <sup>^</sup>	45	45
		21-32 mm Ø/2.0-3.0 mm wall*				30	30
		21-32 mm Ø/2.0-3.0 mm wall, with bundle of cables up to 21 mm* diameter				45	30

All metal or stainless steel pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).  
 All plastic pipe classifications are pipe end configuration U/C (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal applied to both sides of the wall

<sup>^</sup> Or 344 mm diameter when incorporating a pipe of seal diameter -20 mm.





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 15/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Walls								
Substrate	Minimum Substrate Thickness (mm)	Services	Sealant Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Maximum Seal Size	Fire Resistance (mins.)	
							E	EI
Drywall/ Masonry/ Concrete	100	None (blank)	12.5	Stone wool 35-140 kg/m <sup>3</sup>	20	300 x 300 mm*	120	120
		Cables up to 21 mm Ø, single or in bundles up to 50 mm Ø	12.5	Stone wool min. 33 kg/m <sup>3</sup>	12.5		120	90
		Electrical cables up to 21 mm Ø, single or in bundles up to 100 mm Ø	25	Stone wool min. 40 kg/m <sup>3</sup>	20		120	120
		Electrical cables up to 80 mm Ø, single or in bundles up to 100 mm Ø		AES Fibre ≥ 128kg/m <sup>3</sup>	25		120	60
		Telecommunication cables up to 21 mm Ø single or in bundles up to 100 mm Ø	Stone wool min. 40 kg/m <sup>3</sup>	20	120		120	
		Single 'E cable' - 1 x 185 mm <sup>2</sup> core HD603.3 electrical cable with PVC insulation, PVC sheath and 23-27 mm diameter	12.5	Stone wool min. 140 kg/m <sup>3</sup>	20		120	60

\* Or 30 mm wide x 3000 mm high for cables up to 21 mm Ø

\*\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 16/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided* Penetration Seals in Walls 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic</b>							
Substrate	Minimum Substrate Thickness (mm)	Services	Sealant Depth (mm)	Backing Material	Maximum Annular Space (mm)	Fire Resistance (mins.)	
						E	EI
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1							
Drywall/ Masonry/ Concrete	100	Maximum diameter 40 mm, wall thickness 1.0-1.9 mm for PVC pipes, fully or partially filled conduits with cables up to 21 mm diameter	25	none	30	120	120
PE pipe according to EN 1519-1, EN 12201-2 and EN 12006-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1							
Drywall/ Masonry/ Concrete	100	Maximum diameter 40 mm, wall thickness 2.0-3.0 mm for PE pipes, fully or partially filled conduits with cables up to 21 mm diameter	25	none	30	90	90
PP pipe according to EN 1852-1: 2009							
Drywall/ Masonry/ Concrete	100	Maximum diameter 40 mm, wall thickness 1.8-2.2 mm for PP pipes, fully or partially filled conduits with cables up to 21 mm diameter	25	none	30	90	90

All pipe classifications are pipe end configuration U/C and C/C (U=Uncapped, C=Capped).

\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 17/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Walls 300 x 300 mm maximum seal size.							
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Sealant Depth (mm)	Backing Material	Insulation CS	Fire Resistance (mins.)	
						E	EI
Drywall/ Masonry/ Concrete	100	22 mm diameter/3-10 mm wall	25	Stone wool, 25 mm deep, 35 kg/m <sup>3</sup>	None	120	120
		40 mm diameter/1-14.2 mm wall	12.5	Stone wool, 20 mm deep, 40 kg/m <sup>3</sup>		120	120
		40 mm diameter/1-14.2 mm wall*	25	25 mm AES Fibre ≥ 128kg/m <sup>3</sup>	13 -19 mm Elastomeric insulation minimum class B-s3,d0	120	60
		50 mm diameter/1.3-14.2 mm wall*					
		60 mm diameter/1.6-14.2 mm wall*					
		75 mm diameter/2-14.2 mm wall*					
		90 mm diameter/2.4-14.2 mm wall*					
		100 mm diameter/2.7-14.2 mm wall*					
		115 mm diameter/3.1-14.2 mm wall*					
		140 mm diameter/3.8-14.2 mm wall*					
165 mm diameter/ 4.5-14.2 mm wall*							

CS = Continuous Sustained

All pipe classifications are pipe end configuration C/C (C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal applied to both sides of the wall





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 18/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided* Penetration Seals in Walls							
Substrate	Minimum Substrate Thickness (mm)	Services – Copper Pipe (fitted centrally)	Sealant Depth (mm)	Backing Material	Insulation CS	Fire Resistance (mins.)	
						E	EI
Drywall/ Masonry/ Concrete	100	12 mm diameter/1 mm wall	25 mm	25 mm AES Fibre $\geq$ 128kg/m <sup>3</sup>	9 mm Elastomeric insulation minimum class B-s3,d0	120	120
		12-54 mm diameter/1-1.2 mm wall			9-13 mm Elastomeric insulation minimum class B-s3,d0	120	60
		12-54 mm diameter/1-1.2 mm wall			13-25 mm Elastomeric insulation minimum class B-s3,d0	60	60
Substrate	Minimum Substrate Thickness (mm)	Services – Alupex Composite Pipe (fitted centrally)	Sealant Depth (mm)	Backing Material	Insulation CS	Fire Resistance (mins.)	
						E	EI
Drywall/ Masonry/ Concrete	100	16 mm diameter/2.25 mm wall	25 mm	25 mm AES Fibre $\geq$ 128kg/m <sup>3</sup>	9 mm Elastomeric insulation minimum class B-s3,d0	120	120
		16 mm diameter/2.25 mm wall			9-25 mm Elastomeric insulation minimum class B-s3,d0	60	60
		20 mm diameter/2.5 mm wall					
		26 mm diameter/3 mm wall					
		32 mm diameter/3 mm wall					
		40 mm diameter/3.5 mm wall					
		50 mm diameter/4 mm wall					
		63 mm diameter/4.5 mm wall					
		75 mm diameter/4.7 mm wall					

All pipe classifications are pipe end configuration C/C (C=Capped).

\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 19/44  
 Date of Issue 2020-04-29

## Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided\*\* Penetration Seals in Walls 12.5 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 12.5 mm deep stone wool insulation minimum 35 kg/m<sup>3</sup> backing - Maximum seal size 300 x 300 mm or 504 mm Ø

Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Seal Width Around Pipe (a1)	Insulation CS	Fire Resistance (mins.)	
					E	EI
Drywall/ Masonry/ Concrete	100	40 mm diameter/1.0-14.2 mm wall*	10 mm	20 mm Stone wool insulation min. 80 kg/m <sup>3</sup>	120	90
		40 mm diameter/1.0-14.2 mm wall*				
		50 mm diameter/1.2-14.2 mm wall*				
		60 mm diameter/1.4-14.2 mm wall*				
		75 mm diameter/1.6-14.2 mm wall*				
		90 mm diameter/1.9-14.2 mm wall*				
		100 mm diameter/2.1-14.2 mm wall*				
		115 mm diameter/2.4-14.2 mm wall*				
		140 mm diameter/2.9-14.2 mm wall*				
		165 mm diameter/ 3.4-14.2 mm wall*				
		180 mm diameter/ 3.6-14.2 mm wall*				
		200 mm diameter/ 4.0-14.2 mm wall*				
		219 mm diameter/ 4.3-14.2 mm wall*				
		250 mm diameter/ 5.0-14.2 mm wall*				
300 mm diameter/ 5.9-14.2 mm wall*						
324 mm diameter/ 6.35-14.2 mm wall*						
30-80 mm thick stone, mineral wool min. 80 kg/m <sup>3</sup>						
Substrate	Minimum Substrate Thickness (mm)	Services – PEX pipe in pipe system (fitted centrally)	Seal Width Around Pipe (a1)	Insulation	Fire Resistance (mins.)	
Drywall/ Masonry/ Concrete	100	15 mm diameter x 2.5 mm wall inner /25mm diameter outer	10 mm	None	E	EI
					120	120
Substrate	Minimum Substrate Thickness (mm)	Services – Alupex pipe in pipe system (fitted centrally)	Seal Width Around Pipe (a1)	Insulation	Fire Resistance (mins.)	
Drywall/ Masonry/ Concrete	100	16-20 mm diameter/ 2.0 mm wall	10 mm	None	120	120
		16-75 mm diameter/2.25-4.6 mm		20-50 mm thick glass wool or stone, mineral wool min. 75 kg/m <sup>3</sup>		

CS = Continuous Sustained

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped) Except PEX and Alupex pipes which are C/C.

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 20/44  
 Date of Issue 2020-04-29

## Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided\*\* Penetration Seals in Walls 12.5 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 12.5 mm deep stone wool insulation minimum 35 kg/m<sup>3</sup> backing - Maximum seal size 300 x 300 mm or 504 mm Ø


Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe	Seal Width Around Pipe (a1)	Insulation CS	Fire Resistance (mins.)	
					E	EI
Drywall/ Masonry/ Concrete	100	4 mm diameter/1.0-2.0 mm wall	10 mm	None	90	90
		5-30 mm diameter/1.0-14.2 mm wall*			120	120
		30 mm diameter/2.0-14.2 mm wall				
Substrate	Minimum Substrate Thickness (mm)	Copper or Steel pipe	Seal Width Around Pipe (a1)	Insulation	Fire Resistance (mins.)	
Drywall/ Masonry/ Concrete	100	6-12 mm diameter/0.7-6.0 mm wall	10 mm	None	90	60
		13-22 mm diameter/0.7-11 mm wall			90	30
		12-54 mm diameter/0.9-1.2 mm wall			120	60
				20-80 mm thick stone, mineral wool min. 80 kg/m <sup>3</sup>		

CS = Continuous Sustained

All pipe classifications are pipe end configuration C/C, except for those marked “#” which are C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal applied to both sides of the wall

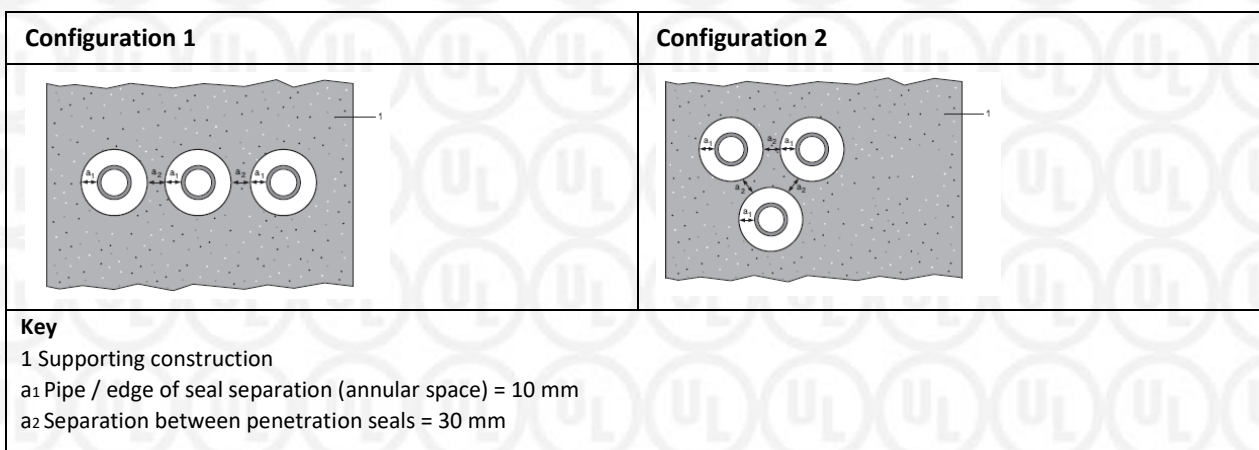



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 21/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided* Penetration Seals in Walls Maximum seal size 300 x 300 mm							
Substrate	Minimum Substrate Thickness (mm)	Services – Gerberit Mepla MLC (PE-Xb/Aluminium/PE-HD pipe) (fitted centrally)	Sealant Depth (mm)	Backing Material (Minimum)	Insulation (Minimum) LI or CI	Fire Resistance (mins.)	
						E	EI
Drywall/ Masonry/ Concrete	100	16 mm diameter/2.25 mm wall	12.5 mm	12.5 mm Stone wool 40 kg/m <sup>3</sup>	20 mm Stone wool 80 kg/m <sup>3</sup> , 500 mm length from both sides of the seal	120	120
		20 mm diameter/2.5 mm wall					
		26 mm diameter/3 mm wall					
		32 mm diameter/3 mm wall					
		40 mm diameter/3.5 mm wall					
		50 mm diameter/4 mm wall					
		63 mm diameter/4.5 mm wall					
75 mm diameter/4.7 mm wall							

LI = Local Interrupted  
 CI = Continuous Interrupted

All pipe classifications are pipe end configuration C/C (C=Capped).

\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 22/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Walls Maximum seal size 300 x 300 mm / min. 10 mm seal width around service</b>							
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Sealant Depth (mm)	Backing Material (Minimum)	Insulation (Minimum) LI or CI	Fire Resistance (mins.)	
						E	EI
Drywall/ Masonry/ Concrete	100	Copper or steel pipe up to 54 mm diameter/1-14.2 mm wall	12.5 mm	20 mm Stone wool 40 kg/m <sup>3</sup>	500 mm length of 20 mm Stone wool 80 kg/m <sup>3</sup>	120	120
		Alupex composite pipe 75 mm diameter/7.5 mm wall		20 mm Stone wool 140 kg/m <sup>3</sup>	600 mm length of 25 mm AES Fibre ≥ 128kg/m <sup>3</sup>	60	60
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Sealant Depth (mm)	Backing Material (Minimum)	Insulation (Minimum) LI or CI	Fire Resistance (mins.)	
Drywall/ Masonry/ Concrete	100	40 mm diameter/1-14.2 mm wall	12.5	20mm Stone wool 40 kg/m <sup>3</sup>	500 mm length of 20 mm stone wool 80 kg/m <sup>3</sup>	120	120
		40 mm diameter/1-14.2 mm wall*			500 mm length of 30 mm stone wool 80 kg/m <sup>3</sup>	120	90
		50 mm diameter/1.2-14.2 mm wall*					
		60 mm diameter/1.4-14.2 mm wall*					
		75 mm diameter/1.7-14.2 mm wall*					
		90 mm diameter/2-14.2 mm wall*					
		100 mm diameter/2.2-14.2 mm wall*					
		115 mm diameter/2.5-14.2 mm wall*					
		140 mm diameter/3-14.2 mm wall*					
		165 mm diameter/3.5-14.2 mm wall*					
		180 mm diameter/3.8-14.2 mm wall*					
		200 mm diameter/4.2-14.2 mm wall*					
219 mm diameter/4.5-14.2 mm wall*							

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

LI = Local Interrupted

CI = Continuous Interrupted

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 23/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided* Penetration Seals in Walls 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic</b>							
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Sealant Depth (mm)	Backing Material	Maximum Annular Space (mm)	Fire Resistance (mins.)	
						E	EI
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1							
Drywall/ Masonry/ Concrete	100	6-32 mm Ø/1.0-2.4 mm wall*	25	None	10	120	120
		6-32 mm Ø/1.0-1.6 mm wall#			30	120	90
PP pipe according to EN 1451-1							
Drywall/ Masonry/ Concrete	100	20 mm Ø/2.2 mm wall	25	none	30	120	120
		20 mm Ø/2.2-4.4 mm wall*				60	60
		20-32 mm Ø/1.8-4.4 mm wall#					
PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1							
Drywall/ Masonry/ Concrete	100	20 mm Ø/2.0 mm wall	25	none	30	120	120
		20-32 mm Ø/2.0-3.0 mm wall#				90	90
Uponor Wirsbo PEX pipe in pipe system according to ISO 15875							
Drywall/ Masonry/ Concrete	100	Diameter up to 54 mm/0.4 mm wall thickness (outer pipe), 28 mm diameter/4.0 mm wall thickness (inner pipe)#	25	none	30	60	45

All pipe classifications are pipe end configuration U/C, except for those marked “#” which are C/C (U=Uncapped, C=Capped).

\* seal applied to both sides of the wall





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 24/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided* Penetration Seals in Walls Min. 10 mm seal width around service							
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Sealant Depth (mm)	Backing Material (Minimum)	Insulation	Fire Resistance (mins.)	
						E	EI
Drywall/ Masonry/ Concrete	100	Mild or stainless steel pipe, 30 -324 mm diameter /1.6-14.2 mm wall#	15 mm	15 mm Stone wool 35 kg/m <sup>3</sup>	None	120	120
		Copper or steel pipe, 12 -54 mm diameter /0.9-14.2 mm wall		15 mm Stone wool 33 kg/m <sup>3</sup>	None	120	120
		Alupex composite pipe 16-75 mm diameter/2.0-4.6 mm wall		15 mm Stone wool 35 kg/m <sup>3</sup>	None	120	30

All pipe classifications are pipe end configuration C/C, except for those marked “#” which are C/U (U=Uncapped, C=Capped).

\* seal applied to both sides of the wall



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 25/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Floors							
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally*)	Sealant Depth (mm)	Backing Material	Aperture Ø (mm)	Fire Resistance (mins.)	
						E	EI
Concrete	150	Single electrical cables up to 21 mm Ø	25	AES Fibre ≥ 128kg/m <sup>3</sup> 25 mm deep	82 Ø or max. 100 x 1000	120	60

\* for circular seals or min. 30 mm from the edges of rectilinear apertures

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Floors Installed to top side of floor / 10 mm seal width around service							
Substrate	Minimum Substrate Thickness (mm)	Services	Sealant Depth (mm)	Backing Material	Aperture (mm)	Fire Resistance (mins.)	
						E	EI
Concrete	150	Blanks Seals	15	20 mm Stone wool 35 kg/m <sup>3</sup>	300 x 300	90	60
			25	25 mm Stone wool 35 kg/m <sup>3</sup>		120	120
		25	Electric cables up to 21 mm diameter, single. 23-27 mm diameter, 1 mm × 185 mm <sup>2</sup> core, PVC sheath and insulation electrical cable, single	48 mm AES Fibre ≥ 128kg/m <sup>3</sup>		240	240
						120	90
240	240						



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 26/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Floors 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 48 mm deep stone wool insulation 33 kg/m <sup>3</sup> backing - Maximum seal size 300 x 300 mm or 300 mm Ø							
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Sealant Depth (mm)	Backing Material	Minimum Annular Space (mm)	Fire Resistance (mins.)	
						E	EI
Mild or stainless steel pipe							
Concrete	150	4 -16 mm diameter /1.0-8.0 mm wall#	25	48 mm stone wool	10	120	120
		17 -324 mm diameter /1.0-14.2 mm wall#				120	0
Copper or steel pipe							
Concrete	150	6 mm diameter /0.7-3.0 mm wall	25	48 mm stone wool	10	120	120
		6 -15 mm diameter /0.7-7.5 mm wall				120	60
		16 - 54 mm diameter /0.7-14.2mm wall				120	0
Copper or steel pipe with 80 kg/m <sup>3</sup> density stone wool insulation Continuous Sustained (CS)							
Concrete	150	12 mm diameter/0.9-6 mm wall, 20-80 mm insulation	25	48 mm stone wool	10	240	240
		13-54 mm diameter/0.9-14.2 mm wall, 20-80 mm insulation*				240	180
Alupex Pipe							
Concrete	150	16 -20 mm diameter/2.0 mm wall	25	48 mm stone wool	10	120	120
		21-75 mm diameter/2.0-4.6 mm wall				120	90
		16-75 mm diameter/2.25-4.6 mm wall with 20-50 mm thick glass wool or stone, mineral wool min. 75 kg/m <sup>3</sup> insulation Continuous Sustained (CS)				180	120

All pipe classifications are pipe end configuration C/C, except for those marked “#” which are C/U (C=Capped, U=Uncapped). Except for Mild or stainless steel pipe which are C/U (C=Capped, U=Uncapped)

\* Typical pipe diameters shown, intermediate sizes are possible.





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 27/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Floors 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 25 mm deep stone wool insulation 33 kg/m<sup>3</sup> backing - Maximum seal size 300 x 300 mm or 300 mm Ø</b>							
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Sealant Depth (mm)	Backing Material	Minimum Annular Space (mm)	Fire Resistance (mins.)	
						E	EI
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1							
Concrete	150	Up to 50 mm Ø/1.6-3.7 mm wall Up to 40 mm Ø/1.6-3.7 mm wall, with bundle of cables up to 21 mm diameter	25	25 mm stone wool	10	240	240
PP pipe according to EN 1451-1							
Concrete	150	12 mm Ø/1.2 mm wall	25	25 mm stone wool	10	240	240
		13-75 mm Ø/1.2-6.8 mm wall*				90	90
		Up to 40 mm Ø/1.2-1.8 mm wall, with bundle of cables up to 21 mm diameter				180	180
PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1							
Concrete	150	20-40 mm Ø/2.0-2.4 mm wall*	25	25 mm stone wool	10	240	240
		Up to 40 mm Ø/2.0-2.4 mm wall, with bundle of cables up to 21 mm diameter				180	180

All pipe classifications are pipe end configuration U/C and C/C (U=Uncapped, C=Capped).

\* Typical pipe diameters shown, intermediate sizes are possible.

\*\* seal fitted to both faces of the floor



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 28/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided* Penetration Seals in Floors Min. 7 mm seal width around service</b>							
Substrate	Minimum Substrate Thickness (mm)	Services (fitted centrally)	Sealant Depth (mm)	Backing Material	Aperture (mm)	Fire Resistance (mins.)	
						E	EI
Concrete	150	Blank seals	15	25 mm Stone wool 35 kg/m <sup>3</sup>	300 x 300	240	240
		Electric cables up to 21 mm diameter, single or in a bundle.				120	120
		Electric cables 22-50 mm diameter, single or in a bundle.				120	90
		Electric cables 51-80 mm diameter, single or in a bundle.				120	60

\* seal fitted to both faces of the floor



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 29/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Floors							
Substrate	Minimum Substrate Thickness (mm)	Services – Copper or Steel Pipe	Max. Seal Size	Sealant / Backing Depth*	Insulation LI or CI	Fire Resistance (mins.)	
						E	EI
Concrete	150	Up to 54 mm diameter/0.9-14.2 mm wall	10 mm width around pipe	15 mm / 20 mm	Min. 1000 mm of 20 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	180
		Up to 12 mm diameter/0.9-5 mm wall				240	240
		Up to 54 mm diameter/0.9-14.2 mm wall	Up to 100 x 1000 mm	25 mm / 20 mm		120	120
		Up to 54 mm diameter/0.9-14.2 mm wall	300 x 300 mm	15 mm / 20 mm		90	60
		Up to 12 mm diameter/0.9-5 mm wall		25 mm / 20 mm		120	120
		Up to 54 mm diameter/0.9-14.2 mm wall					

LI = Local Interrupted  
 CI = Continuous Interrupted

\* backed with 40 kg/m<sup>3</sup> stone wool insulation or AES Fibre ≥ 128kg/m<sup>3</sup>.

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 30/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Floors								
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Max. Seal Size	Sealant/Backing**	Insulation min. 1000 mm LI or CI	Fire Resistance (mins.)		
						E	EI	
Concrete	150	40 mm diameter/1-14.2 mm wall	10 mm width around pipe	15 mm / 20 mm	20 mm Stone wool insulation 80 kg/m <sup>3</sup>	240	240	
		40 mm diameter/1-14.2 mm wall						
		50 mm diameter/1.2-14.2 mm wall*						
		60 mm diameter/1.4-14.2 mm wall*						
		75 mm diameter/1.7-14.2 mm wall*						
		90 mm diameter/2-14.2 mm wall*						
		100 mm diameter/2.2-14.2 mm wall*						
		115 mm diameter/2.5-14.2 mm wall*						
		140 mm diameter/3-14.2 mm wall*						
		165 mm diameter/3.5-14.2 mm wall*						
		180 mm diameter/3.8-14.2 mm wall*						
		200 mm diameter/4.2-14.2 mm wall*						
		219 mm diameter/4.5-14.2 mm wall*						
	50 mm diameter/1.2-14.2 mm wall*							
	60 mm diameter/1.4-14.2 mm wall*							
	75 mm diameter/1.7-14.2 mm wall*							
	90 mm diameter/2-14.2 mm wall*							
	100 mm diameter/2.2-14.2 mm wall*							
	115 mm diameter/2.5-14.2 mm wall*							
	140 mm diameter/3-14.2 mm wall*							
	165 mm diameter/3.5-14.2 mm wall*							
	180 mm diameter/3.8-14.2 mm wall*							
	200 mm diameter/4.2-14.2 mm wall*							
	219 mm diameter/4.5-14.2 mm wall*							

LI = Local Interrupted  
 CI = Continuous Interrupted

\*\* backed with 40 kg/m<sup>3</sup> stone wool insulation or AES Fibre ≥ 128kg/m<sup>3</sup>. All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).  
 \* Typical pipe diameters, intermediate sizes are possible.



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 31/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in Floors							
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Max. Seal Size	Sealant / Backing**	Insulation min 1000 mm LI or CI	Fire Resistance (mins.)	
						E	EI
Concrete	150	40 mm diameter/1-14.2 mm wall	300 x 300 mm	15 mm / 20 mm	20 mm Stone wool insulation 80 kg/m <sup>3</sup>	90	60
		40 mm diameter/1-14.2 mm wall			30 mm Stone wool insulation 80 kg/m <sup>3</sup>		
		50 mm diameter/1.2-14.2 mm wall*					
		60 mm diameter/1.4-14.2 mm wall*					
		75 mm diameter/1.7-14.2 mm wall*					
		90 mm diameter/2-14.2 mm wall*					
		100 mm diameter/2.2-14.2 mm wall*					
		115 mm diameter/2.5-14.2 mm wall*					
		140 mm diameter/3-14.2 mm wall*					
		165 mm diameter/3.5-14.2 mm wall*					
		180 mm diameter/3.8-14.2 mm wall*					
		200 mm diameter/4.2-14.2 mm wall*					
		219 mm diameter/4.5-14.2 mm wall*					
		40 mm diameter/1-14.2 mm wall		25 mm / 20 mm	20mm Stone wool 80 kg/m <sup>3</sup>	120	90
		50 mm diameter/1.2-14.2 mm wall*			30 mm Stone wool 80 kg/m <sup>3</sup>		
		60 mm diameter/1.4-14.2 mm wall*					
		75 mm diameter/1.7-14.2 mm wall*					
		90 mm diameter/2-14.2 mm wall*					
		100 mm diameter/2.2-14.2 mm wall*					
		115 mm diameter/2.5-14.2 mm wall*					
		140 mm diameter/3-14.2 mm wall*					
		165 mm diameter/3.5-14.2 mm wall*					
		180 mm diameter/3.8-14.2 mm wall*					
		200 mm diameter/4.2-14.2 mm wall*					
219 mm diameter/4.5-14.2 mm wall*							

LI = Local Interrupted

CI = Continuous Interrupted

\*\*backed with 40 kg/m<sup>3</sup> stone wool insulation or AES Fibre ≥ 128kg/m<sup>3</sup>. All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters, intermediate sizes are possible.



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 32/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Single Sided Penetration Seals in floors 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic / 48 mm deep AES Fibre ≥ 128kg/m<sup>3</sup> backing - Maximum seal size 300 x 300 mm or 504 mm Ø</b>						
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Seal Width Around Pipe (a1)	Insulation CS	Fire Resistance (mins.)	
					E	EI
Masonry/ Concrete	150	40 mm diameter/1.0-14.2 mm wall*	10 mm	20 mm thick stone, mineral wool min. 80 kg/m <sup>3</sup>	240	240
		40 mm diameter/1.0-14.2 mm wall*				
		50 mm diameter/1.2-14.2 mm wall*				
		60 mm diameter/1.4-14.2 mm wall*				
		75 mm diameter/1.6-14.2 mm wall*				
		90 mm diameter/1.9-14.2 mm wall*				
		100 mm diameter/2.1-14.2 mm wall*				
		115 mm diameter/2.4-14.2 mm wall*				
		140 mm diameter/2.9-14.2 mm wall*				
		165 mm diameter/ 3.4-14.2 mm wall*				
		180 mm diameter/ 3.6-14.2 mm wall*				
		200 mm diameter/ 4.0-14.2 mm wall*				
		219 mm diameter/ 4.3-14.2 mm wall*				
		250 mm diameter/ 5.0-14.2 mm wall*				
300 mm diameter/ 5.9-14.2 mm wall*						
324 mm diameter/ 6.35-14.2 mm wall*						
30-80 mm thick stone, mineral wool min. 80 kg/m <sup>3</sup>						
Substrate	Minimum Substrate Thickness (mm)	Services – PEX pipe in pipe system (fitted centrally)	Seal Width Around Pipe (a1)	Insulation	Fire Resistance (mins.)	
Concrete	150	15 mm diameter x 2.5 mm wall inner /25mm diameter outer	10 mm	None	E	EI
					90	90

CS = Continuous Sustained

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped) Except PEX pipes which are C/C.



\* Typical pipe diameters shown, intermediate sizes are possible.





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
Page 33/44  
Date of Issue 2020-04-29

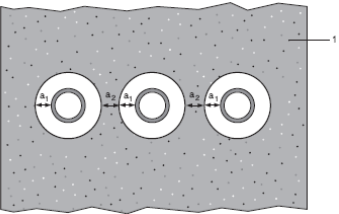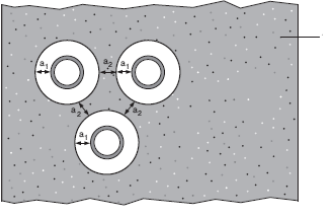Configuration 1	Configuration 2
	
<p><b>Key</b></p> <p>1 Supporting construction</p> <p>a1 Pipe / edge of seal separation (annular space) = 10 mm</p> <p>a2 Separation between penetration seals = 30 mm</p>	

# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 34/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acrylic: Single Sided Penetration Seals in Floors Maximum seal size 300 x 300 mm							
Substrate	Minimum Substrate Thickness (mm)	Services – Gerberit Mepla MLC (PE-Xb/Aluminium/PE-HD pipe (fitted centrally))	Sealant Depth	Backing	Insulation CI	Fire Resistance (mins.)	
						E	EI
Concrete	150	16 mm diameter/2.25 mm wall	25 mm	48 mm AES Fibre $\geq$ 128kg/m <sup>3</sup>	20 mm Stone wool 80 kg/m <sup>3</sup> , 500 mm length from both sides of the seal	240	240
		20 mm diameter/2.5 mm wall					
		26 mm diameter/3 mm wall					
		32 mm diameter/3 mm wall					
		40 mm diameter/3.5 mm wall					
		50 mm diameter/4 mm wall					
		63 mm diameter/4.5 mm wall					
75 mm diameter/4.7 mm wall							

CI = Continuous Interrupted

All pipe classifications are pipe end configuration C/C (C=Capped).



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 35/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Floors 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic</b>							
Substrate	Minimum Substrate Thickness (mm)	Services	Max. Seal Size	Backing	Insulation	Fire Resistance (mins.)	
						E	EI
Concrete	150	Copper or steel pipe 54 mm diameter/2-14.2 mm wall	300 x 300 mm	25 mm deep 140 kg/m <sup>3</sup> Stone wool	None	120	20
		Mild steel pipe 16 mm diameter/1.5-7.5 mm wall				240	240
		Mild steel pipe 16 mm diameter/1.5-7.5 mm wall	Up to 100 x 1000 mm	25 mm deep AES Fibre ≥ 128kg/m <sup>3</sup>		120	120

\* Seal to both faces of floor

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 36/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Floors 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic							
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Max. Seal Size	Backing	Insulation CS	Fire Resistance (mins.)	
						E	EI
Concrete	150	40 mm diameter/1-14.2 mm wall	300 x 300 mm	20 mm Stone wool 40 kg/m <sup>3</sup>	13 -19 mm Elastomeric insulation minimum class B-s3,d0 or phenolic foam insulation	180	180
		40 mm diameter/1-14.2 mm wall*		25 mm AES Fibre ≥ 128kg/m <sup>3</sup>		60	60
		50 mm diameter/1.3-14.2 mm wall*					
		60 mm diameter/1.6-14.2 mm wall*					
		75 mm diameter/2-14.2 mm wall*					
		90 mm diameter/2.4-14.2 mm wall*					
		100 mm diameter/2.7-14.2 mm wall*					
		115 mm diameter/3.1-14.2 mm wall*					
		140 mm diameter/3.8-14.2 mm wall*					
165 mm diameter/ 4.5-14.2 mm wall*							

CS = Continuous Sustained

\* Typical pipe diameters, intermediate sizes are possible.

\*\* seal to both faces of floor



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 37/44  
 Date of Issue 2020-04-29

<b>Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided* Penetration Seals in Floors 25 mm deep Bostik FP 310 Intumescent Acoustic Acrylic</b>							
Substrate	Minimum Substrate Thickness (mm)	Services – Copper Pipe or Steel	Max. Seal Size	Backing	Insulation CS	Fire Resistance (mins.)	
						E	EI
Concrete	150	12 mm diameter/1 mm wall	300 x 300 mm	25 mm AES Fibre ≥ 128kg/m <sup>3</sup>	9 mm Elastomeric insulation minimum class B-s3,d0 or phenolic foam insulation	240	180
		12-54 mm diameter/1-1.2 mm wall			9-13 mm Elastomeric insulation minimum class B-s3,d0 or phenolic foam insulation	180	120
		12-54 mm diameter/1-1.2 mm wall			13-25 mm Elastomeric insulation minimum class B-s3,d0 or phenolic foam insulation	90	60
Substrate	Minimum Substrate Thickness (mm)	Alupez Composite Pipe	Max. Seal Size	Backing	Insulation CS	Fire Resistance (mins.)	
						E	EI
Concrete	150	16 mm diameter/2.25 mm wall	300 x 300 mm	25 mm AES Fibre ≥ 128kg/m <sup>3</sup>	9 mm Elastomeric insulation minimum class B-s3,d0 or phenolic foam insulation	180	180
		16 mm diameter/2.25 mm wall			9-13 mm Elastomeric insulation minimum class B-s3,d0 or phenolic foam insulation	120	60
		20 mm diameter/2.5 mm wall					
		26 mm diameter/3 mm wall					
		32 mm diameter/3 mm wall					
		40 mm diameter/3.5 mm wall					
		50 mm diameter/4 mm wall			13-25 mm Elastomeric insulation minimum class B-s3,d0 or phenolic foam insulation	60	60
		63 mm diameter/4.5 mm wall					
		75 mm diameter/4.7 mm wall					
		16 mm diameter/2.25 mm wall					
		20 mm diameter/2.5 mm wall					
		26 mm diameter/3 mm wall					
		32 mm diameter/3 mm wall					
		40 mm diameter/3.5 mm wall					
		50 mm diameter/4 mm wall					
63 mm diameter/4.5 mm wall							
75 mm diameter/4.7 mm wall							

CS = Continuous Sustained  
 All pipe classifications are pipe end configuration C/C (C=Capped).  
 \* Seal to both faces of floor



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 38/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Double Sided** Penetration Seals in Floors 15 mm deep Bostik FP 310 Intumescent Acoustic Acrylic							
Substrate	Minimum Substrate Thickness (mm)	Services – Mild or Stainless Steel Pipe (fitted centrally)	Max. Seal Size	Backing	Insulation Min. 1000 mm LI or CI	Fire Resistance (mins.)	
						E	EI
Concrete	150	40 mm diameter/1-14.2 mm wall	300 x 300 mm or 100 x 1000 mm	20 deep 40 kg/m <sup>3</sup> stone wool insulation	20 mm Stone wool 80 kg/m <sup>3</sup>	240	240
		40 mm diameter/1-14.2 mm wall*					
		50 mm diameter/1.2-14.2 mm wall*			30 mm Stone wool 80 kg/m <sup>3</sup>	240	120
		60 mm diameter/1.4-14.2 mm wall*					
		75 mm diameter/1.7-14.2 mm wall*					
		90 mm diameter/2-14.2 mm wall*					
		100 mm diameter/2.2-14.2 mm wall*					
		115 mm diameter/2.5-14.2 mm wall*					
		140 mm diameter/3-14.2 mm wall*					
		165 mm diameter/3.5-14.2 mm wall*					
		180 mm diameter/3.8-14.2 mm wall*					
		200 mm diameter/4.2-14.2 mm wall*					
219 mm diameter/4.5-14.2 mm wall*							

LI = Local Interrupted)  
 CI = Continuous Interrupted

All pipe classifications are pipe end configuration C/U (U=Uncapped, C=Capped).

\* Typical pipe diameters, intermediate sizes are possible.

\* seal to both faces of floor





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 39/44  
 Date of Issue 2020-04-29

## Bostik FP 310 Intumescent Acoustic Acrylic: Linear Gaps Head of Flexible Wall to Concrete Floor Soffit and Vertical End of Flexible Wall and Concrete Wall

Substrates	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position/Orientation	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Fire Resistance (mins.)	
							E	EI
Plasterboard & Concrete	100	30	Both Sides, Horizontal Joint	12.5	Stone wool 35 kg/m <sup>3</sup> plus 50 mm steel partition head track	12.5	120	120
			Both Sides, Vertical Joint		Stone wool 35 kg/m <sup>3</sup> *	20		
		Both Sides, Horizontal Joint	25	50				
	75	25	Both Sides, Horizontal Joint	12.5	50 mm steel partition head track / stud	50	90	90
			Both Sides, Vertical Joint					
		25	Both Sides, Horizontal Joint	12.5		50 mm steel partition head track / stud		

\* Maximum partition/wall height of 3 metres.



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 40/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Vertically or Horizontally Orientated Linear Joints or Gap seals in Flexible or Rigid Walls									
Substrates	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position/Orientation	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Facing Material (minimum)	Fire Resistance (mins.)	
								E	EI
Flexible or rigid wall / Timber	100	30	One Side, Vertical Joint	12.5	Stone wool 35 kg/m <sup>3</sup>	12.5	Single sided linear seals in flexible or rigid walls against wooden frames covered with architraves on the other side fixed with 25 mm steel pins at nominal 300 mm centres.	60	60
			One Side, Horizontal Joint						
			Both Sides, Vertical Joint					90	60
			Both Sides, Horizontal Joint						
Steel / Steel			One Side, Vertical Joint			None	120	30	
			One Side, Horizontal Joint						
Flexible or rigid wall / Steel			Both Sides, Vertical Joint				120 <sup>1</sup>	30 <sup>2</sup>	
			Both Sides, Horizontal Joint						120 <sup>3</sup>

Single sided seals may be either side (or any position between) of the wall.

\*Additional and for information only.

The classifications provided in the table above consider the insulation performance of all components within the firestopping system as per the requirements of EN 1366-4. This includes temperature evaluation of the steel substrate.

In relation to each of the above classifications, temperatures recorded on the seal (exclusive of the supporting construction) exceeded the maximum allowable after the following times (rounded down):

<sup>1</sup> 120, <sup>2</sup> 90, <sup>3</sup> 120, <sup>4</sup> 60



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 41/44  
 Date of Issue 2020-04-29

## Bostik FP 310 Intumescent Acrylic: Linear Gaps Head of Rigid Wall to Concrete Floor Soffit and Between Rigid Walls

Substrates	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position/ Orientation	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Fire Resistance (mins.)	
							E	EI
Masonry/ Concrete	150	30	One Side, Horizontal Joint	25	Stone wool 40 kg/m <sup>3</sup>	20	240	60
			Both Sides, Vertical or Horizontal Joint	15			240	240
			One Side, Horizontal Joint	25	AES Fibre ≥ 128kg/m <sup>3</sup>	48	240	120
		50	One Side, Vertical joint	10	Stone wool 33 kg/m <sup>3</sup>	60	120	120
			One Side, horizontal joint				240	60

Single sided seals may be either side (or any position between) of the wall.





# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 42/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acrylic: Linear Gaps Between Concrete Floor Slabs or Between Floor Slab and Rigid Wall								
Substrate	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Fire Resistance (mins.)	
							E	EI
Masonry/ Concrete	150	100	Either face	25	AES Fibre $\geq$ 128kg/m <sup>3</sup>	25	120	60
			Top face				180	180
		Both sides	25	Stone wool 40 kg/m <sup>3</sup>	25	120	120	
			15	Stone wool 140 kg/m <sup>3</sup>		180	180	
		30	Both sides	15	Stone wool 35 kg/m <sup>3</sup>	240	240	
		100	Top face	10	Stone wool 33 kg/m <sup>3</sup>	90	240	240



# Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01134-CPR  
 Page 43/44  
 Date of Issue 2020-04-29

Bostik FP 310 Intumescent Acoustic Acrylic: Linear Joints or Gaps in or Between Concrete Floor Slabs								
Substrate	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Fire Resistance (mins.)	
							E	EI
Steel/ steel or Steel/ concrete	150	13	Top face	25	Stone wool 35 kg/m3	50	240 <sup>1</sup>	30 <sup>2</sup>
			Both sides	15		25	240 <sup>3</sup>	45 <sup>4</sup>
			Top face	25		50	180 <sup>5</sup>	20 <sup>6</sup>

\*Additional and for information only.

The classifications provided in the table above consider the insulation performance of all components within the firestopping system as per the requirements of EN 1366-4. This includes temperature evaluation of the steel substrate.

In relation to each of the above classifications, temperatures recorded on the seal (exclusive of the supporting construction) exceeded the maximum allowable after the following times (rounded down):

<sup>1</sup> 240, <sup>2</sup> 60, <sup>3</sup> 240, <sup>4</sup> 120, <sup>5</sup> 180, <sup>6</sup> 60



# Appendix UL-EU Certificate

<b>Certification Mark</b>	<b>UL-EU mark</b>
<b>Certificate No.</b>	UL-EU-01134-CPR
<b>Page</b>	44/44
<b>Date of Issue</b>	2020-04-29

The UL-EU Mark, as displayed below, shall appear on certified products only. Minimum size is not specified, as long as the Mark is legible. The following is suggested.



The minimum height of the registered trademark symbol ® shall be 1 mm. When the overall diameter of the UL-EU Mark is less than 9.5 mm, the trademark symbol may be omitted if it is not legible to the naked eye.

The UL-EU Mark may appear on a label, nameplate, or may be cast, stamped or molded into the product. When appearing on a label or nameplate, the Manufacturer's name or trademark along with a model number are also required on that same label or nameplate. If cast, stamped or molded, the Manufacturer's name or trademark and model number shall also appear elsewhere on the product.

All content shall be in accordance with the details provided on this UL-EU Certificate.

## PROCUREMENT

The Production site may reproduce the Mark or obtain it from a UL authorized supplier. The list of UL authorized suppliers can be found on UL's online directory at [www.ul.com](http://www.ul.com).

